**National Archives and Records Administration (NARA)** 

## Facility Standards for Federal Records Storage Facilities

A quick overview of what Federal Records Officers need to know about:

- What the Records Storage Facility Standards cover
- What agencies must do to meet the standards
- How to find NARA guidance on the standards

This overview should be used in conjunction with the Records Storage Facility Standards Toolkit which is available at <a href="www.archives.gov/records-mgmt/storage-standards-toolkit">www.archives.gov/records-mgmt/storage-standards-toolkit</a> or in hard copy by request to <a href="mailto:frank.quigley@nara.gov">frank.quigley@nara.gov</a>

Version 2.0 August 25, 2008

#### NARA's Authority under 44 U.S.C.

• **36 CFR §1228 subpart K** applies to all records storage facilities (whether Government owned, leased or contractor operated) that Federal agencies use to store, service, and dispose of their records. It specifies the minimum structural, environmental, property, and life-safety standards that a records storage facility must meet to store Federal records.

#### NARA Facilities

NARA is authorized under 44 U.S.C. 2907 to establish, maintain, and operate records centers for Federal agencies.

#### Agency Facilities

NARA authorized under 44 U.S.C. 3103 to approve a records center that is maintained and operated by an agency.

#### Commercial Facilities

NARA is also authorized to promulgate standards, procedures, and guidelines to Federal agencies with respect to the storage of their records in commercial records storage facilities. (44 U.S.C. 2104a, 2904 and 3102).

## What do the Subpart K standards mean to you? (1/2)

- Agencies are responsible for ensuring that records in their legal custody are stored in appropriate space as outlined in 36 CFR 1228 Subpart K
- If the current storage conditions are not in compliance, then the agency is responsible for initiating action to remove records from space that does not meet the Subpart K standards.

## What do the Subpart K standards mean to you? (2/2)

- If your agency stores records in a NARA facility
  - It is NARA's responsibility to make sure the NARA Records Center facility meets the Subpart K standards (see File 1 of the Toolkit).
- If your agency stores records in an agency records center or a commercial records storage facility
  - The agency records officer is responsible for making sure the facility meets the Subpart K standards.
  - The records officer must also submit documentation to NARA (see §1228.240 or Files 2 and 3 of the Toolkit)

## §1228.228 Facility Standards (1/3)

- (a) Must be constructed with non-combustible materials (walls, columns and floors).
- (b) Multi-story facilities must be designed or reviewed by both a licensed fire protection engineer and a civil/structural engineer.
- (c) Must be outside of any 100 year flood plain areas.
- (d) The facility must be designed in accordance with all applicable codes.
- (e) There must be unrestricted emergency vehicle access provided to the facility.
- (f) The floor load limit must be established by a structural engineer & posted in facility.
- (g) The roof system must prevent water from entering the facility. We recommend there not be any roof mounted equipment above records storage areas.

### §1228.228 Facility Standards (2/3)

- (h) No piping (with the exception of fire protection system piping) through records storage areas.
- (i) Records Storage and Racking Systems must:
  - Provide seismic bracing to meet applicable codes.
  - Be designed to prevent collapse under full load.
  - If compact mobile shelving is used, there are specific requirements related to air circulation & fire-protection.
- (j) The records storage area must be equipped with an anti-intrusion alarm system.
- (k) The design of the facility must meet the requirements of a Level III facility as defined by the U.S. Marshals Service.

### §1228.228 Facility Standards (3/3)

- (I) Contaminated records must be stored in a separate storage area on a separate HVAC system.
- (m) The facility must have an integrated pest management program.
- (n) For new records storage facilities (facilities established or converted after September 28, 2005):
  - No motors over 1 HP in records storage areas.
  - No high voltage equipment in records storage areas.
  - Redundant source of primary power should be provided to insure continuous power.
  - Positive air pressure for permanent records storage areas.

## §1228.230 Fire Safety Requirements (1/3)

- (a) Fire detection & suppression designed or reviewed by a licensed fire protection engineer.
- (b) Three-hour fire barrier walls must be provided between storage areas. No more than 250,000 cubic feet of Federal records per storage area.
- (c) Two-hour rated fire barrier walls must be provided between records storage areas and auxiliary spaces,
- (d) All penetrations through fire walls must be sealed with fire stopping material.
- (e) The roof fire rating must be a minimum ½ hour or protected by fire sprinklers.
- (f) Doors between records storage areas must be self-closing and have a Class A rating.

## §1228.230 Fire Safety Requirements (2/3)

- (g) Roof supporting members that cross fire walls must be cut and supported independently on each side of fire barrier.
- (h) Expansion joints in fire barrier walls must be properly protected.
- (i) Building columns in records storage areas must be 1 hour fire resistive or protected in accordance with NFPA 13.
- (j) No automatic roof vents for routine ventilation are allowed in records storage areas. Properly designed roof vents for fire venting are acceptable.
- (k) Light-weight steel must be protected with 10 minute fire resistant coating or large drop sprinkler heads.
- (I) Open flame unit heaters or equipment must be installed in accordance with NFPA 54 and the Uniform Mechanical Code.
- (m) Existing facilities two-hour fire barrier wall separation with no openings between records storage areas and boiler rooms or rooms with fuel supplies (generator rooms).

## §1228.230 Fire Safety Requirements (3/3)


- (n) New facilities four- hour fire barrier wall separation with no openings between records storage areas and boiler rooms or rooms with fuel supplies (generator rooms).
- (o) New facilities fuel supply lines must <u>not</u> be installed in records storage areas. Fuel lines must be separated from records storage areas by four-hour rated construction assemblies.
- (p) Equipment rows running perpendicular to walls must be NFPA 101 compliant.
- (q) No oil-based transformers are permitted in records storage areas light ballast OK. Electrical wiring must be in metal conduit. Battery charging areas for electric forklifts require at least two-hour fire barrier separation from records storage.
- (r) No hazardous materials are permitted to be stored in records storage areas including nitrate film.
- (s) All records storage areas must have a professionally designed fire detection and suppression system designed to limit loss to a maximum of 300 cubic feet in case of a fire.

## §1228.232 Environmental Controls Requirements (1/1)


- (a) Paper-based temporary records must be stored in a manner to prevent mold growth:
  - No leaks or moisture problems
  - Avoid high relative humidity (RH)
    - No greater than 70% RH with any temperature
    - No greater than 55% RH if high temperatures
- (b) Non-textual temporary records must be stored in conditions that preserve them based on their full retention period.
- (c) Paper-based permanent records must be stored in areas with 24 hour / 365 days per year air conditioning equivalent to office space with appropriate temperature, humidity and air-exchanges.
- (d) Non-textual permanent records, unscheduled records and sample/select records must comply with the standards for permanent records.

#### Fire Suppression Performance

The fire detection and suppression system must be designed and installed to limit the maximum anticipated loss in any single fire event to a maximum of 300 cubic feet of records. §1228.230(s)

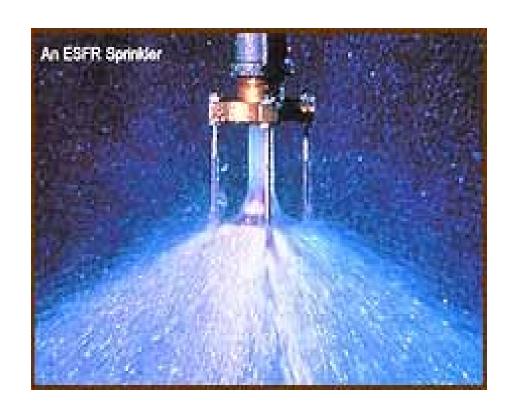

#### Fire Suppression System

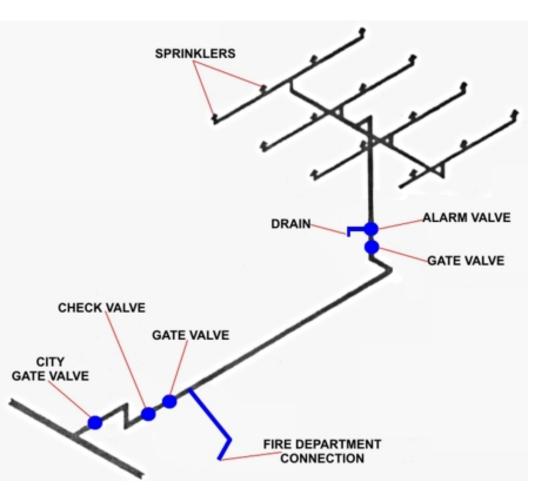

- Must be designed or reviewed by a licensed fire-protection engineer (LFPE) - §1228.230
- Must be documented by one of the following:
- NARA Appendix B
- Live Fire Test
- LFPE Report & Seal -§1228.242

## Part 1228 Appendix B (NARA-certified fire safety systems)

 Contains prescriptive requirements based on live fire testing that have been certified by NARA to meet the fire suppression performance in §1228.230(s) Certifications that form part of the documentation to send to NARA in support of a request for approval of an agency records center or a certification statement by a Federal Records Officer that a commercial records storage facility complies with the 36 CFR 1228, subpart K standards.



- Fire Detection System
- Fire Suppression System
- Floor Load Capacity
- Flood Plain Certification
- Integrated Pest Management
- Intrusion Alarm Certification (UL1076)
- Shelving Design & Installation for Seismic Requirements
- Temporary or Permanent? ASHRAE
   Standard 55 & ASHRAE Standard 62 may be required.
- Certificate of Occupancy

#### **Agency Records Centers**

- An agency must obtain NARA approval to establish or to relocate an agency records center (or prior to using an agency records center operated by another agency).
- NARA will review documentation submitted by the agency to verify the facility meets the requirements of subpart K.

#### See Toolkit File 2

#### Agency Record Center: Exclusion

• §1228.240(b) *Exclusions* 

... excludes agency records staging and/or holding areas with a capacity for containing less than 25,000 cubic feet of records ...

The facility standards still apply.

#### Commercial Records Centers (1/2)

- Before storing agency records in a commercial records storage facility, the agency must
  - ensure that the facility meets the subpart K standards.
  - submit documentation to NARA that shows that the facility meets the standards.
  - ensure that NARA has the right to inspect the facility.

#### Commercial Records Centers (2/2)

- Acceptable documentation required to show compliance with the standards:
  - A copy of the agency's contract with the commercial records storage facility incorporating the Subpart K standards.
  - A statement from the agency's records officer certifying that the facility meets the requirements of Subpart K

#### See Toolkit File 3

## What if the facility does not meet all of the Subpart K requirements?

- Agency can request a waiver from a subpart K requirement.
  - the request for a waiver needs to be accompanied by information explaining how the alternative is equivalent or superior to the standard requirement.
- NARA reviews supporting documentation before approving or denying waiver requests.

# Where do I send documentation for agency records centers, commercial facilities and waiver requests?

#### Send to:

Director, Space & Security
Management Division (NAS)
National Archives and Records
Administration
8601 Adelphi Road
College Park, MD 20740-6001

OR

frank.quigley@nara.gov



#### NARA Web Resources

http://www.archives.gov

Click on: <u>Records</u><u>Managers</u>


 Contains information on NARA guidance and regulations




#### The NARA Public Website is www.archives.gov




#### NARA "Records Managers" Page

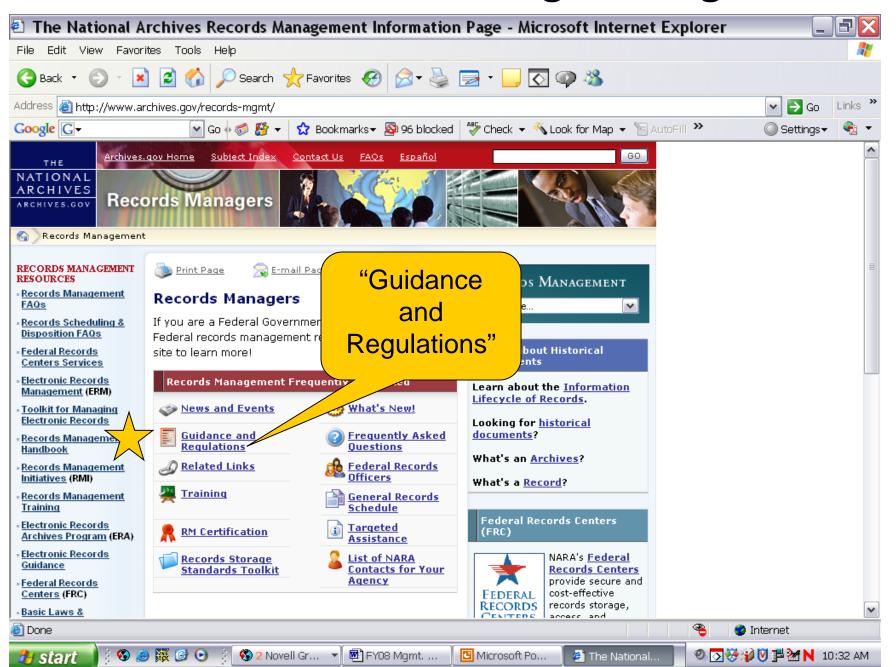


#### NARA Records Management Guidance and Regulations

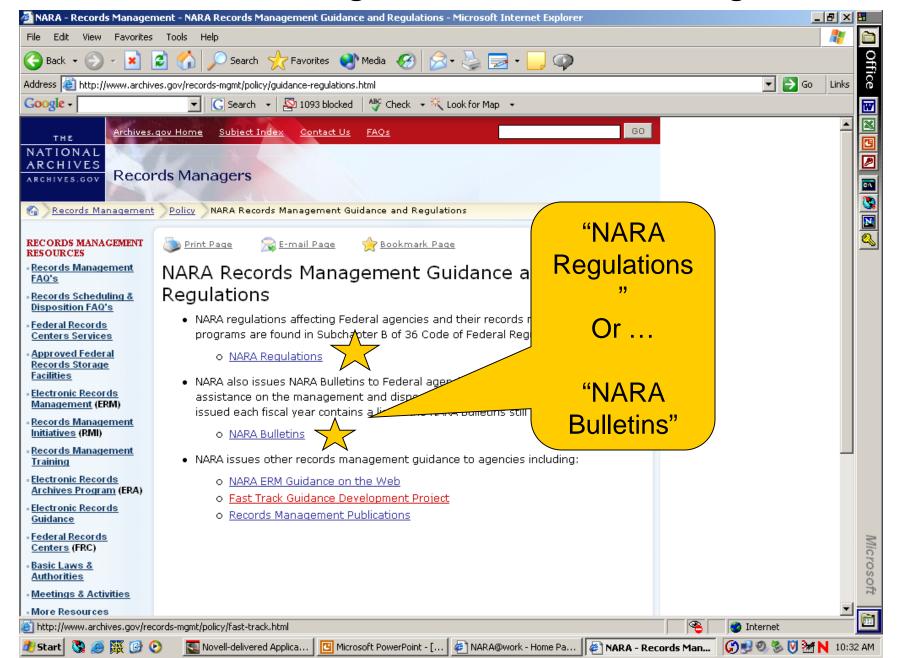

#### **NARA** Regulations

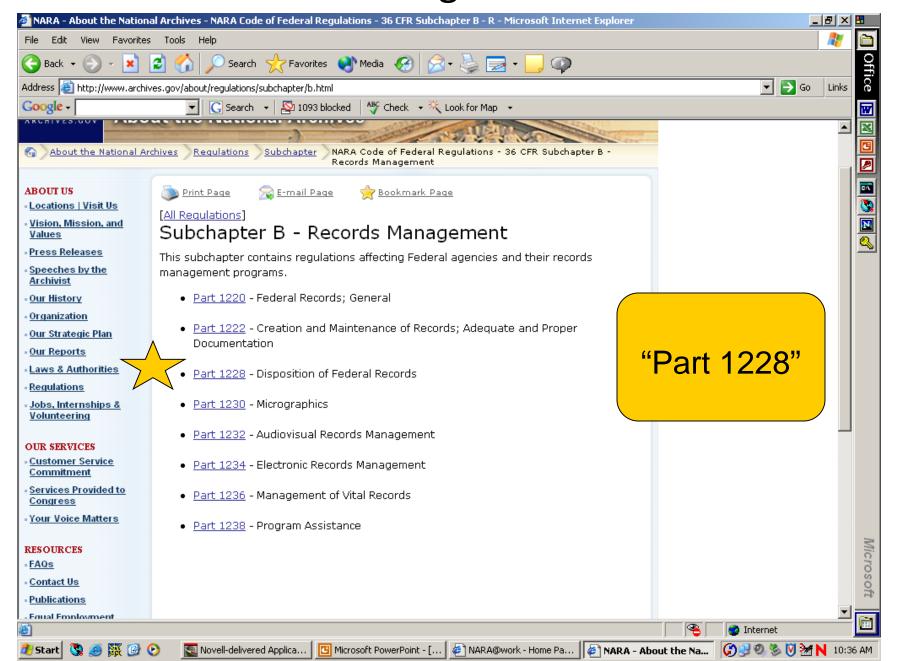

#### NARA Regulations, 1228

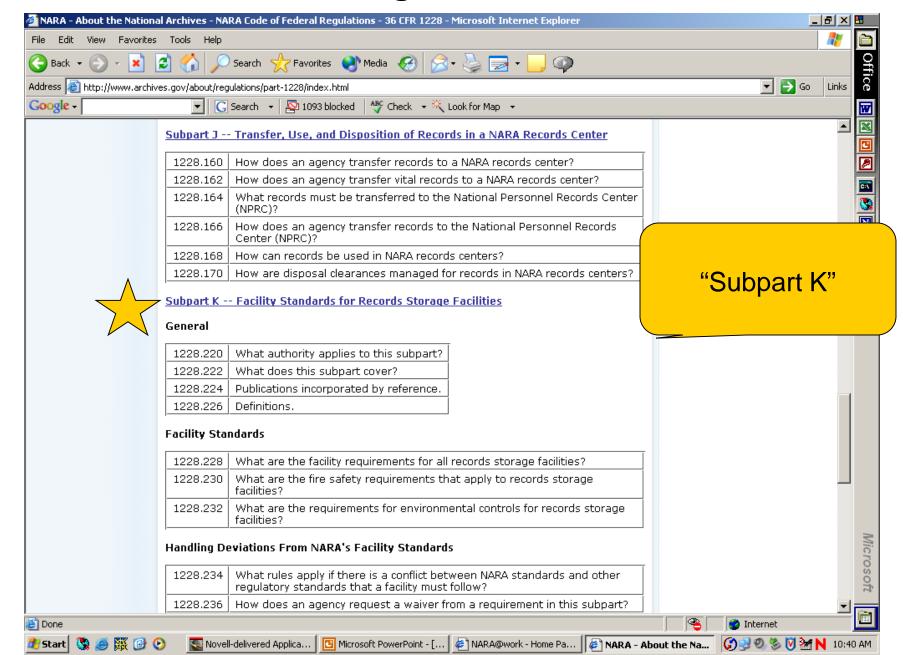

#### **Facility Standards**

